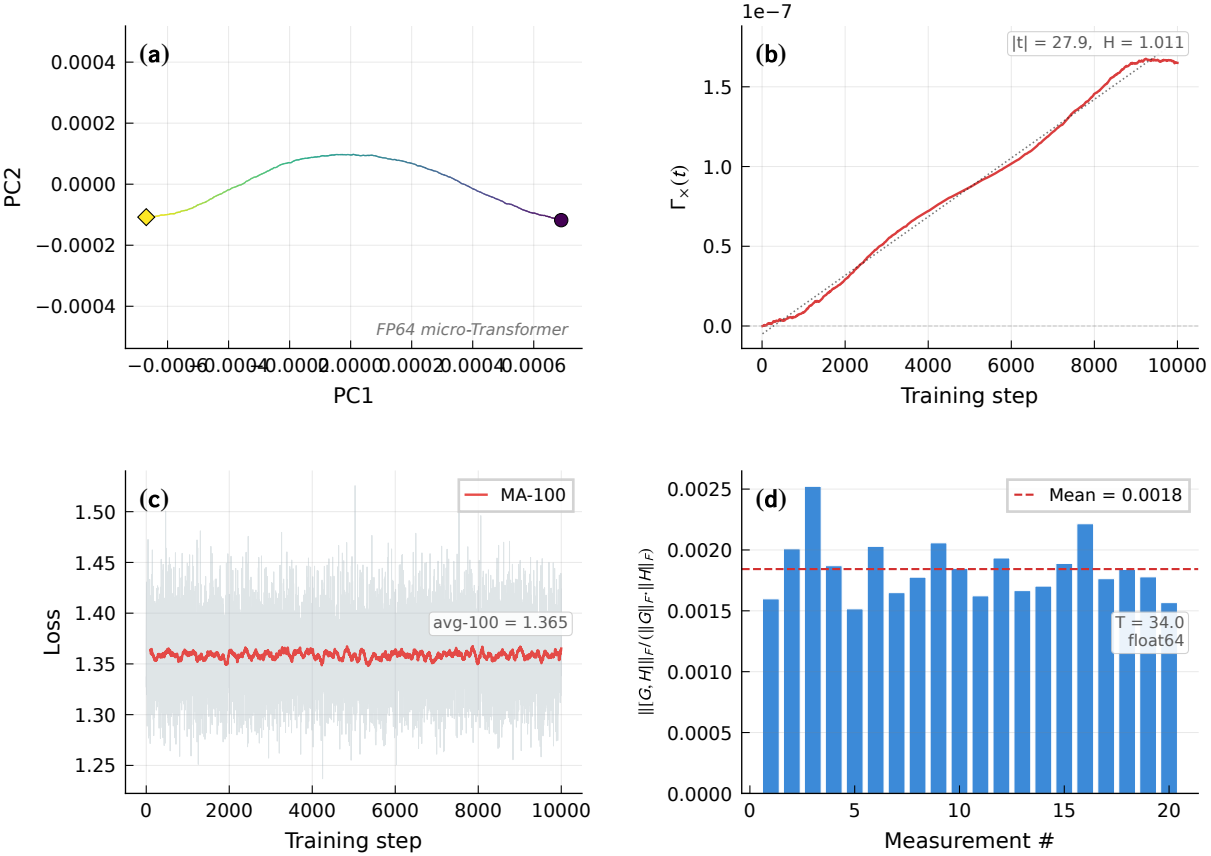
(a)
PC2
PC1
FP64 micro-Transformer
(b)
|t| = 27.9, H = 1.011
1e−7
Γ×(t)
Training step
(c)
MA-100
avg-100 = 1.365
Loss
Training step
(d)
Mean = 0.0018
T = 34.0
float64
Measurement #